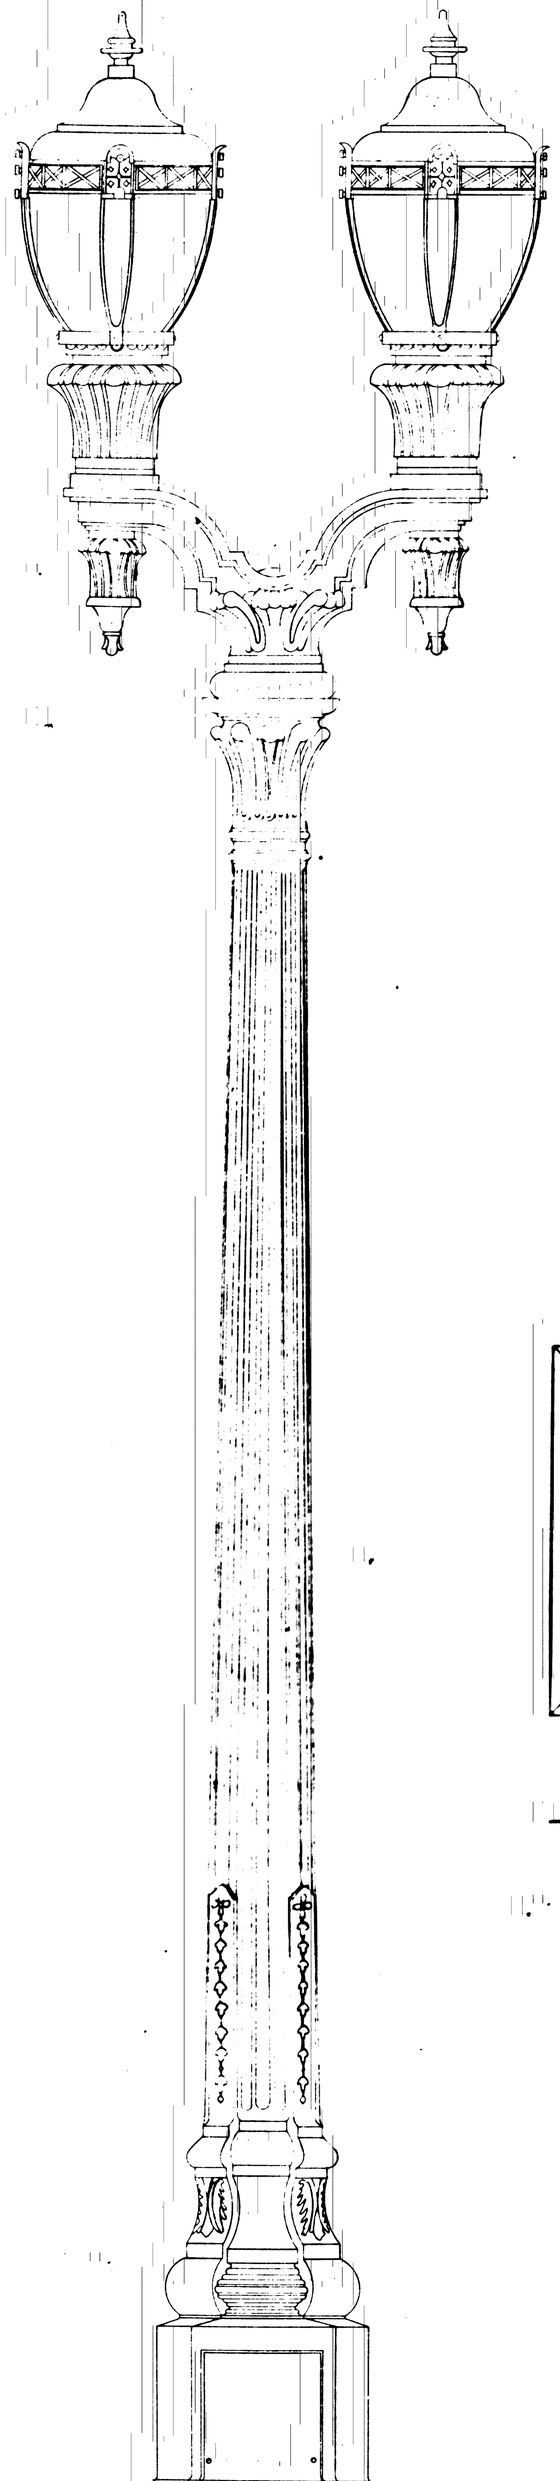

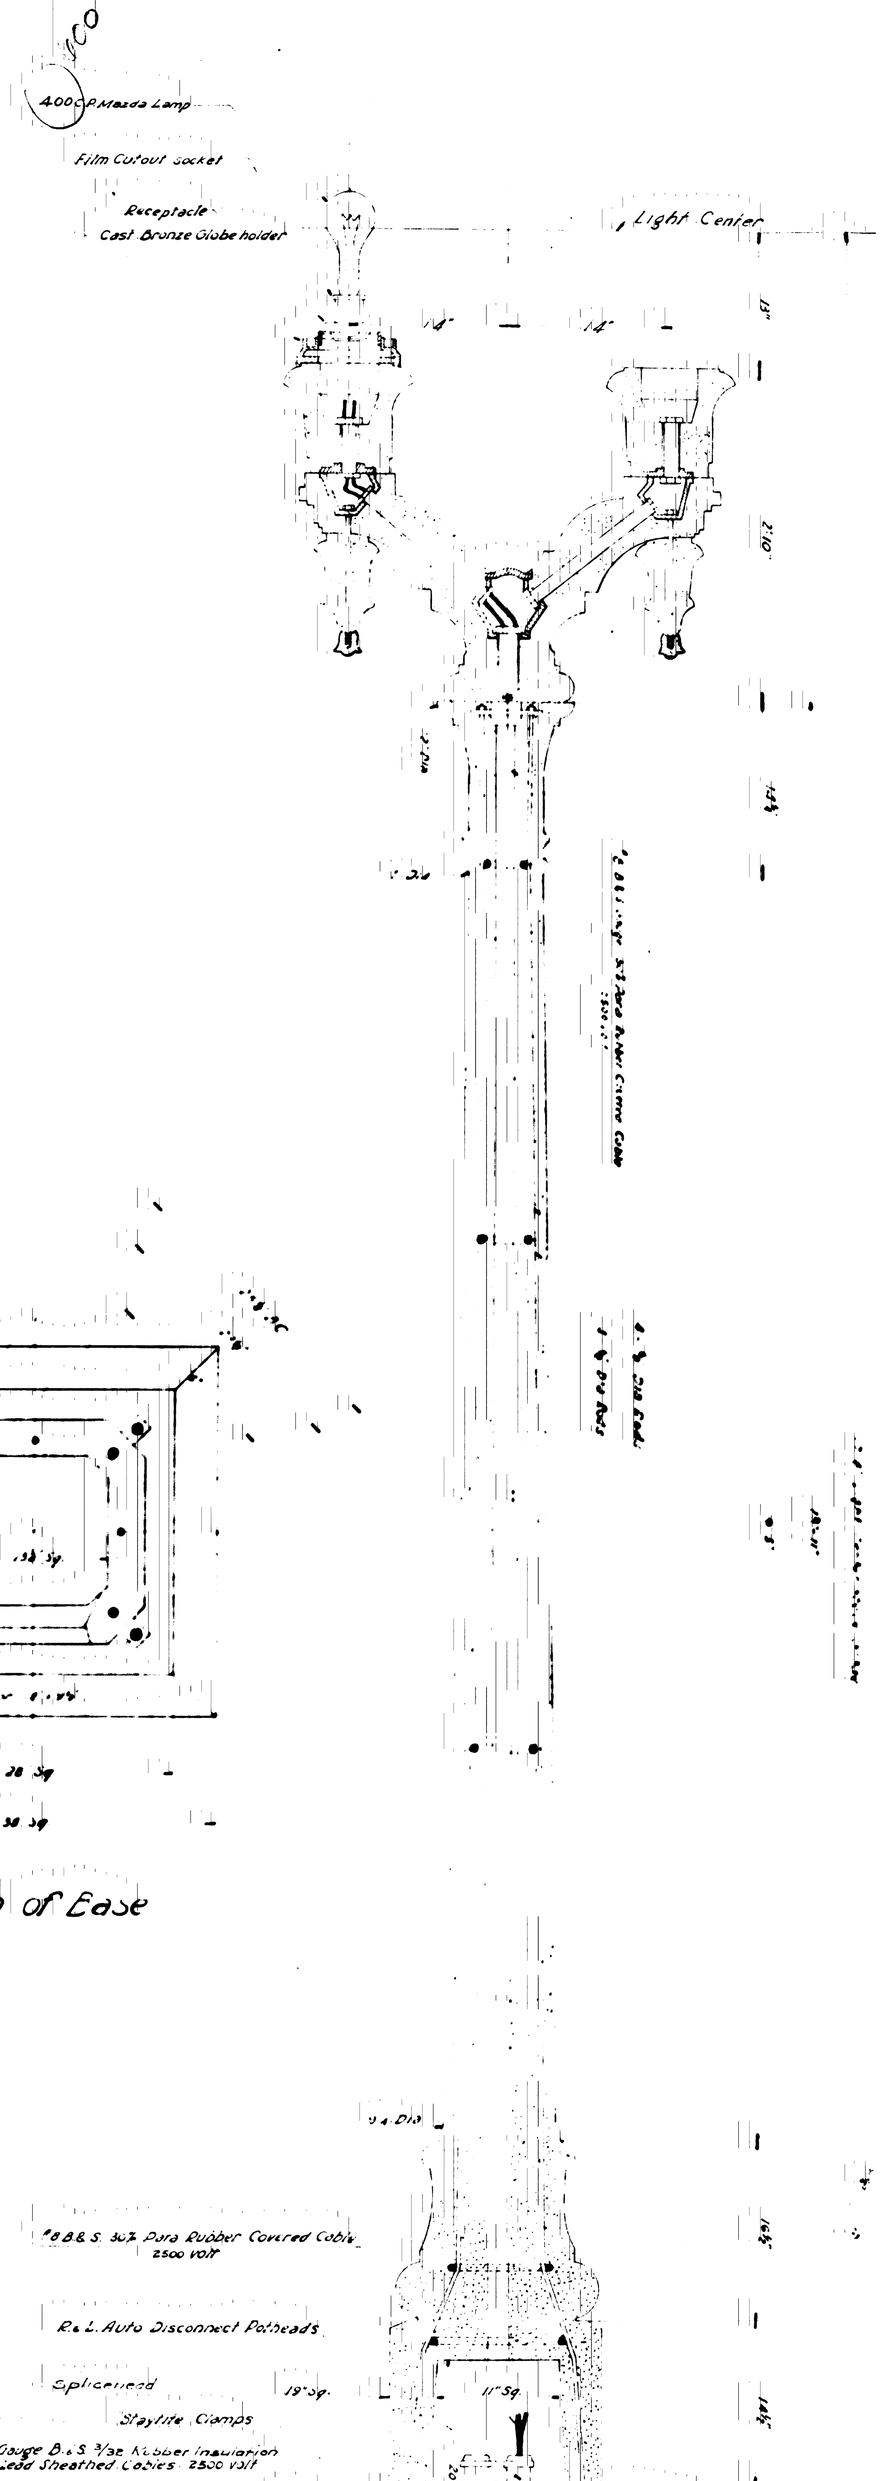

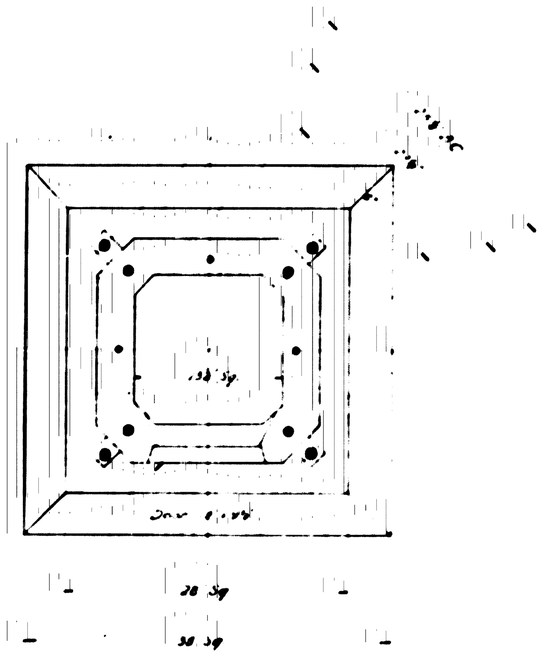

Plan of Base

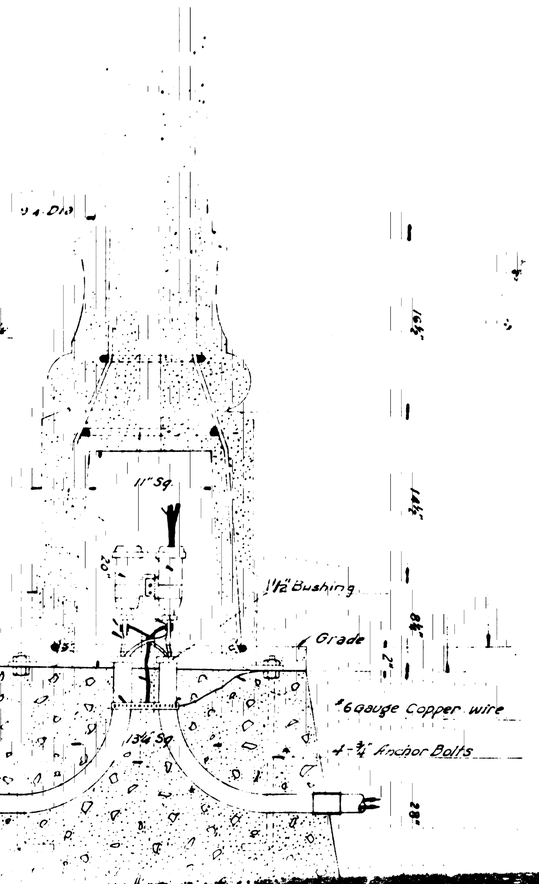

#8 B.& S. 30% Para Rubber Covered Cable 2500 volt

R. & L. Auto Disconnect Potheads

Splicerhead 19" Sq.

Staylite Clamps

#8 Gauge B. & S. 3/32 Rubber Insulation 1/16 Lead Sheathed Cables 2500 volt

19½ Sq.

Copper Ground Strips

Conduit bends to be connected to conduit now in place at this point →

SHEET No 3
PLAN No 1240

STANDARD
TYPE 1912 MARBELITE LIGHTING POST

CITY OF SAN BERNARDINO CALIFORNIA

APRIL 1920

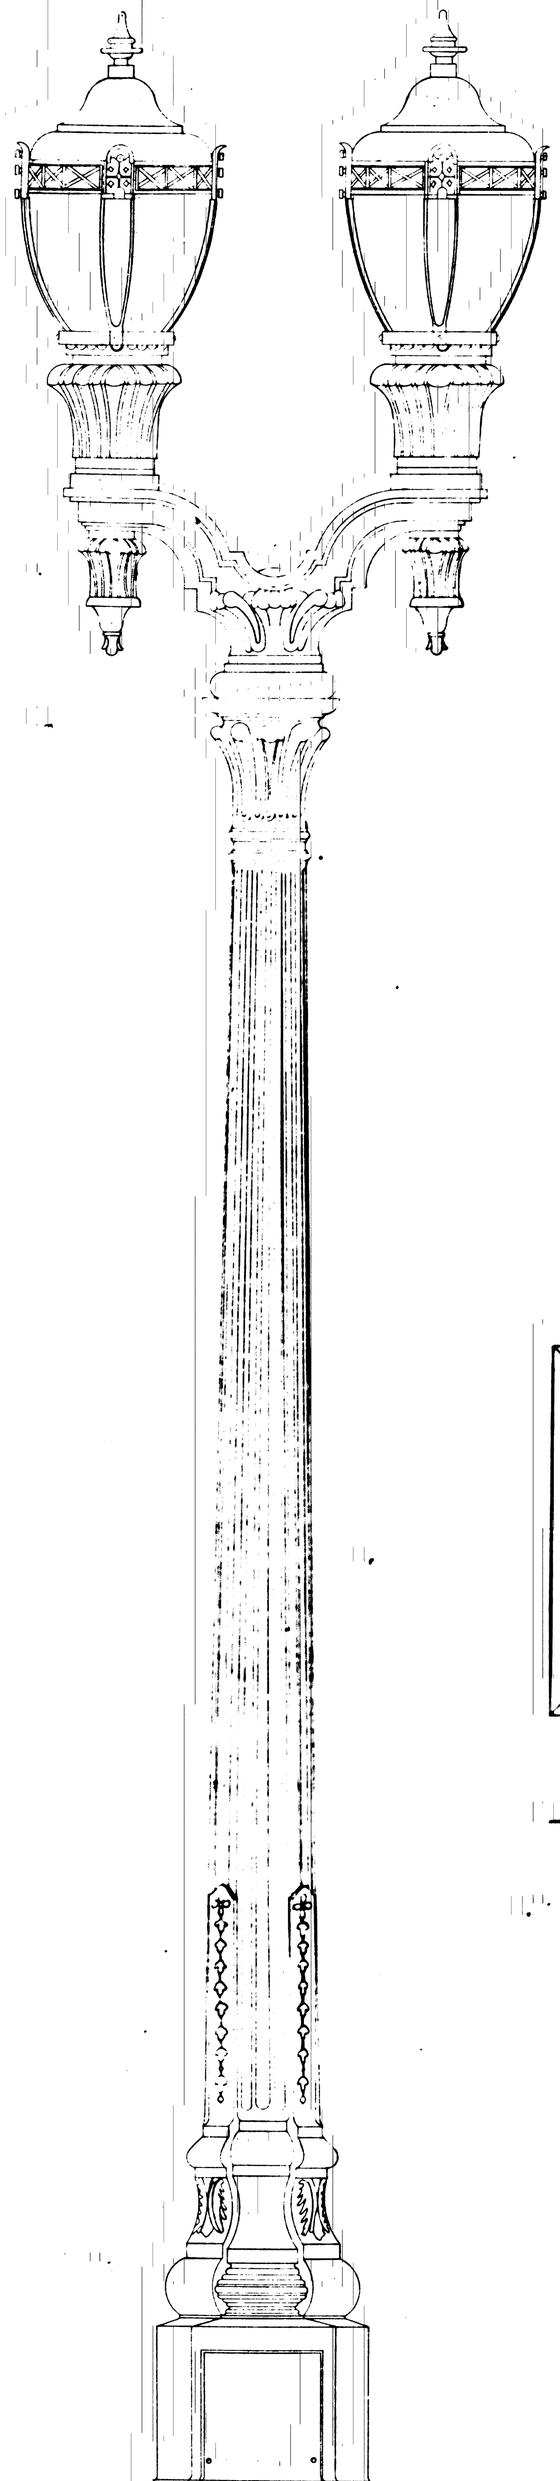

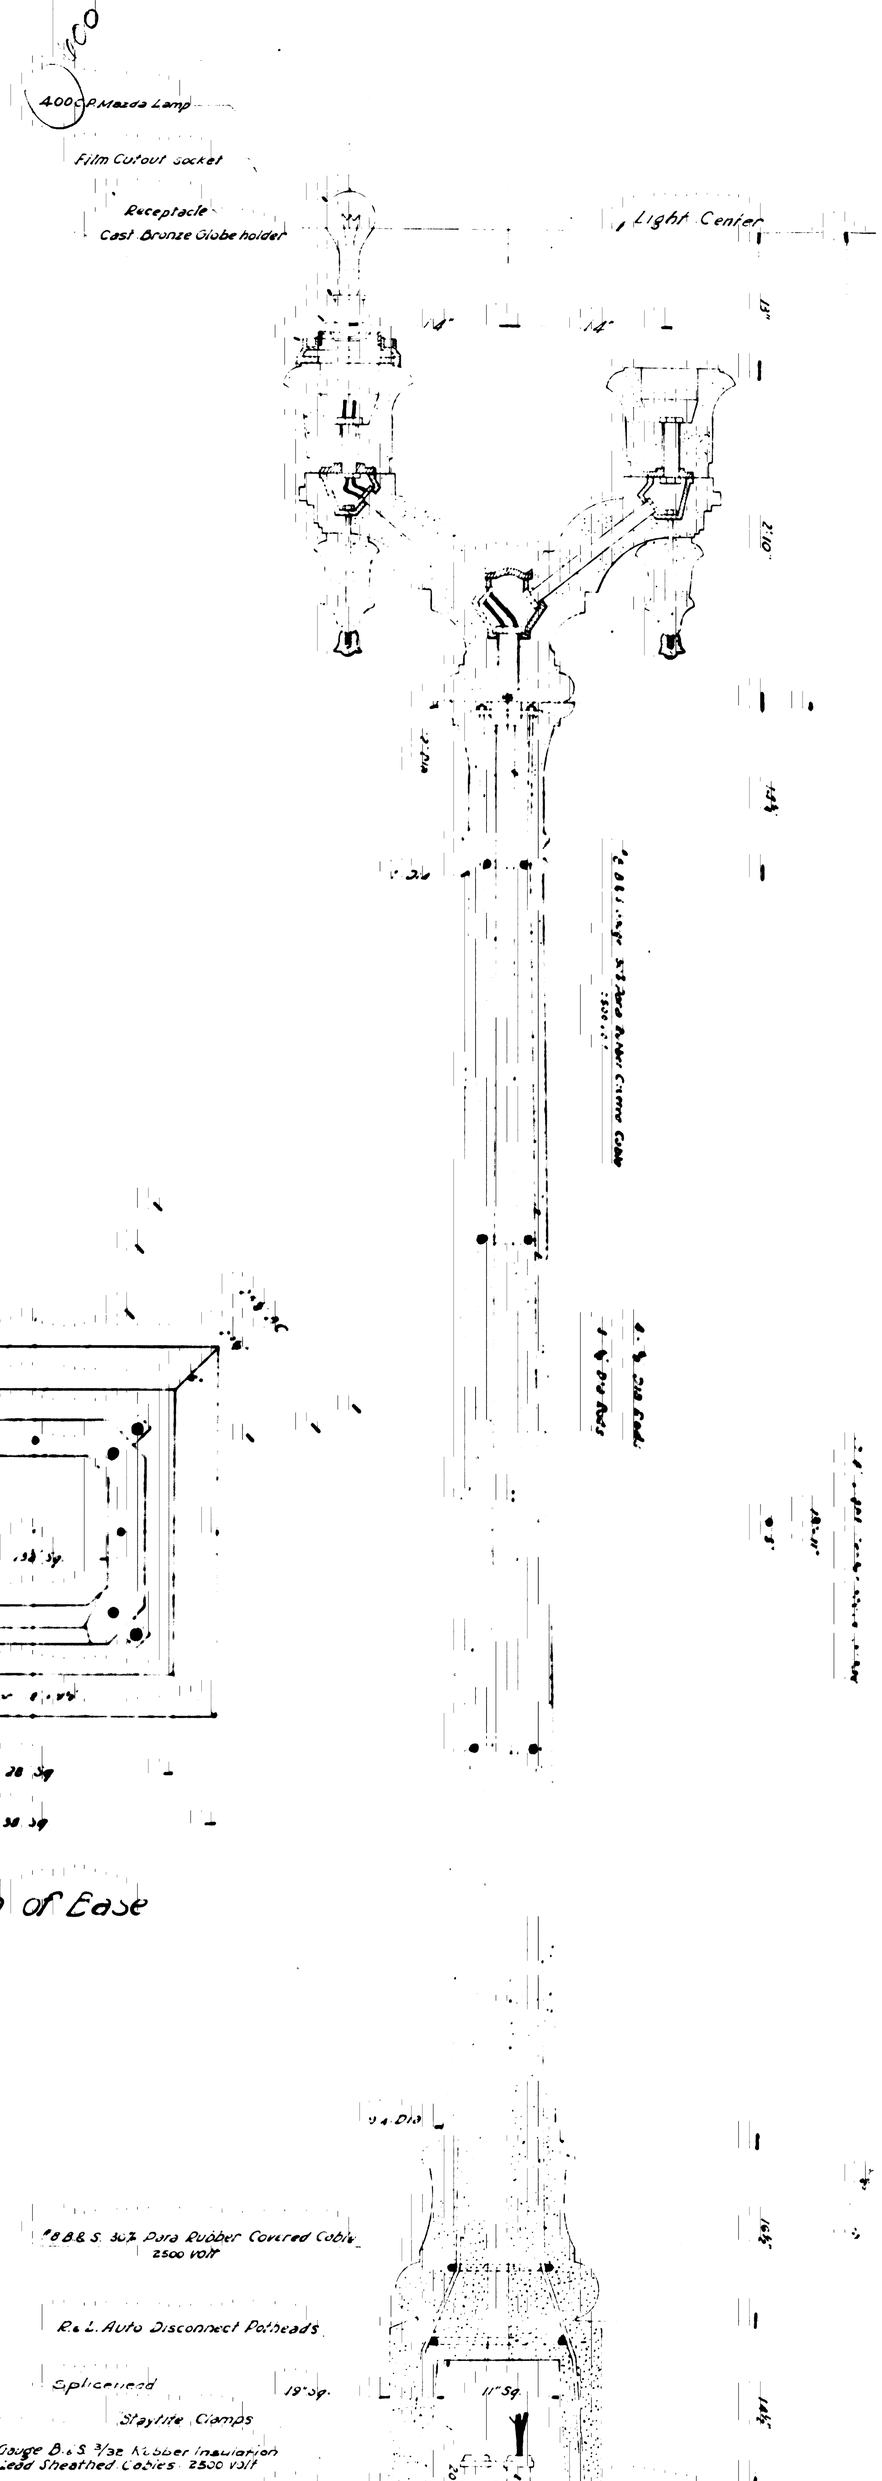

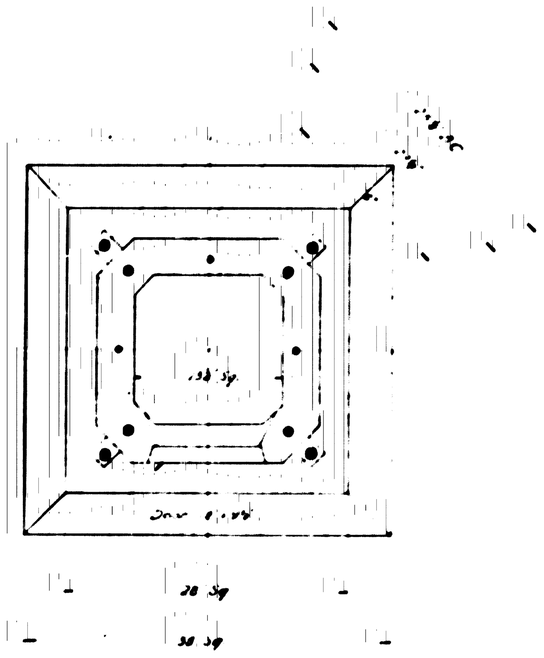

Plan of Base

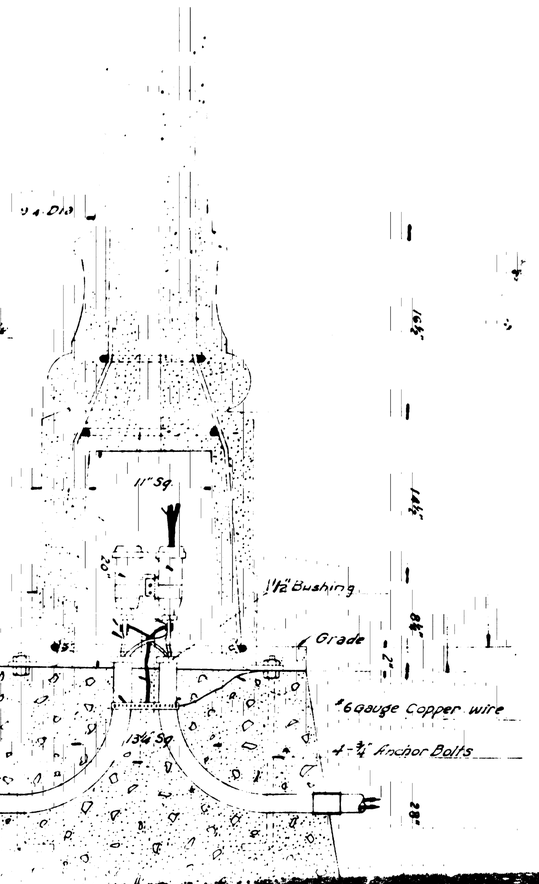

#8 B.& S. 30% Para Rubber Covered Cable 2500 volt

R. & L. Auto Disconnect Potheads

Splicerhead 19" Sq.

Staylite Clamps

#8 Gauge B. & S. 3/32 Rubber Insulation 1/16 Lead Sheathed Cables 2500 volt

19½ Sq.

Copper Ground Strips

Conduit bends to be connected to conduit now in place at this point →

SHEET No 3
PLAN No 1240

STANDARD
TYPE 1912 MARBELITE LIGHTING POST

CITY OF SAN BERNARDINO CALIFORNIA

APRIL 1920