


- NOTES:
1. Manhole frames and covers shall be constructed by steel reinforcement concrete with a minimum thickness of 4 inches. Manhole frames and covers shall be set in concrete with a minimum depth of 18 inches below the finished ground surface.
  2. All elevations shall be 4' V.C.P. and extended 2' beyond property line.
  3. All work shall be done in accordance with the specifications of the City of San Bernardino, California, and the Standard Specifications for Highway Construction, 1957 Edition.
  4. Exact locations of sewer laterals to be determined in the field.
  5. Construct 2 1/2" Plain Milk Pavement in all streets as shown.



SAN BERNARDINO  
 DEPARTMENT OF ENGINEERING  
 CITY OF SAN BERNARDINO  
 IMPROVEMENT PLANS & PROFILES  
 TRACT NO. 5707  
 CALIFORNIA  
 DRAWN BY  
 CHECKED BY  
 DATE

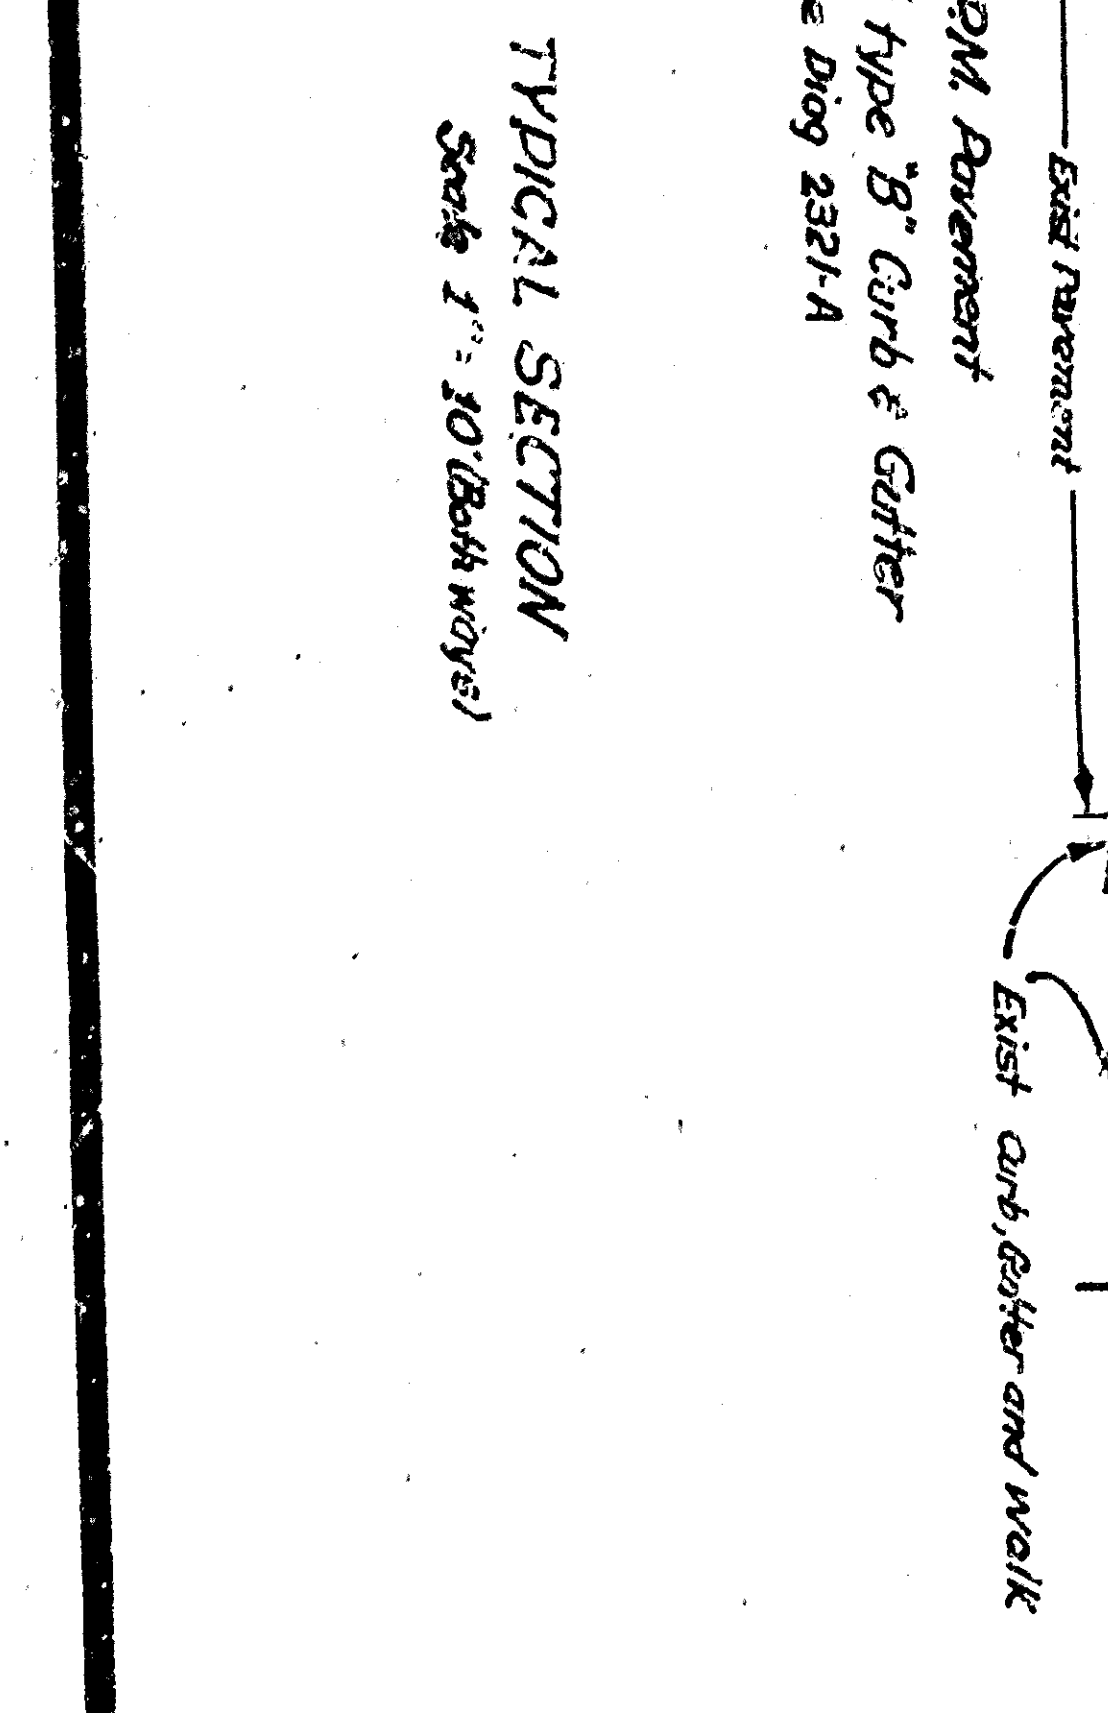