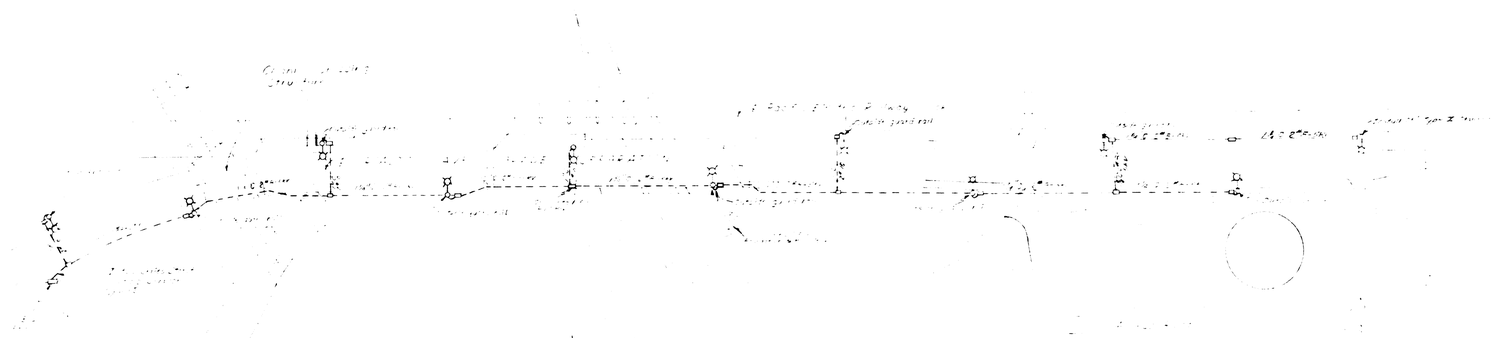

NOTES

1. All material and workmanship shall be done in accordance with section 60 of Standard Specifications, State of California, Department of Public Works, Division of Highways, dated August 1954.
2. STREET LIGHT STANDARDS – Standards [illegible] shall be galvanized steel, type of California Type X, Pacific Union Metal Co. #18 FA130-2-6 or equal, with 6 foot Luminaire mast arms, except standard to be installed at intersection of Muscott and [illegible] which shall be 25 feet.
3. LUMINAIRES – Luminaires to be furnished and installed shall be IES Type III, 2" end Mount with [illegible] reflector, designed for use with 400 Watt Mercury Vapor Lamps.
4. MERCURY LAMP TRANSFORMERS – Mercury Lamp Transformers to be furnished and installed shall be Pole Base Type 6.6 Ampere Primary, 400 Watt, Westinghouse Style 1760548 or equal.
5. MERCURY VAPOR LAMPS – Mercury Vapor Lamps to be furnished and installed shall be 400 Watt, [illegible] "Lite Guard" Type H31-1-CD, 10,000 hour Lamps or equal.
6. Detail Y Conduit expansion Fittings shall be installed at all expansion joints.
7. All Pull Boxes except on Bridge Structure to be #5. Boxes containing Transformers shall be provided with extensions.

[illegible] ORDER #

RIALTO [illegible] GRADE [illegible] TION

[illegible] STREET LIGHTING

[illegible] 59

Ronald [illegible]

9873

716

3

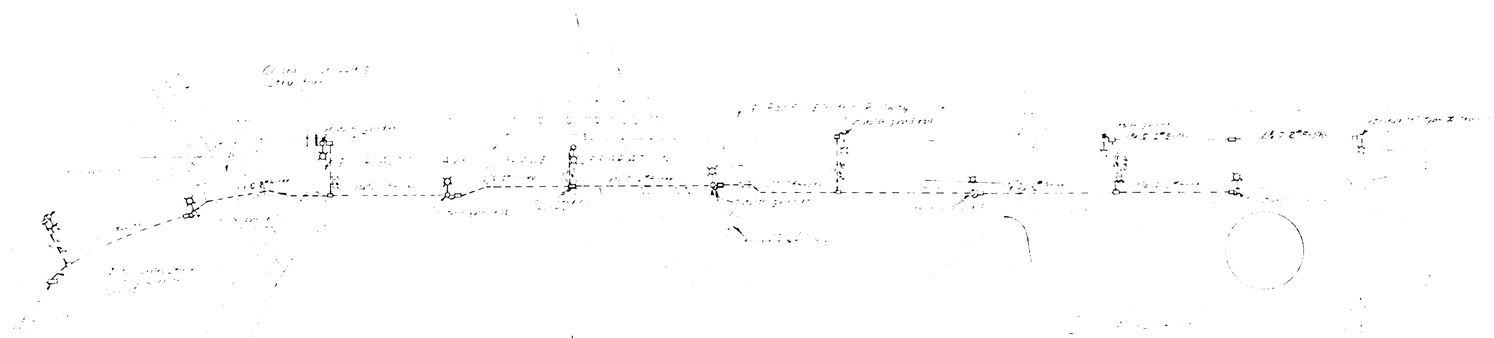

NOTES

1. All material and workmanship shall be done in accordance with section 60 of Standard Specifications, State of California, Department of Public Works, Division of Highways, dated August 1954.
2. STREET LIGHT STANDARDS – Standards [illegible] shall be galvanized steel, type of California Type X, Pacific Union Metal Co. #18 FA130-2-6 or equal, with 6 foot Luminaire mast arms, except standard to be installed at intersection of Muscott and [illegible] which shall be 25 feet.
3. LUMINAIRES – Luminaires to be furnished and installed shall be IES Type III, 2" end Mount with [illegible] reflector, designed for use with 400 Watt Mercury Vapor Lamps.
4. MERCURY LAMP TRANSFORMERS – Mercury Lamp Transformers to be furnished and installed shall be Pole Base Type 6.6 Ampere Primary, 400 Watt, Westinghouse Style 1760548 or equal.
5. MERCURY VAPOR LAMPS – Mercury Vapor Lamps to be furnished and installed shall be 400 Watt, [illegible] "Lite Guard" Type H31-1-CD, 10,000 hour Lamps or equal.
6. Detail Y Conduit expansion Fittings shall be installed at all expansion joints.
7. All Pull Boxes except on Bridge Structure to be #5. Boxes containing Transformers shall be provided with extensions.

[illegible] ORDER #

RIALTO [illegible] GRADE [illegible] TION

[illegible] STREET LIGHTING

[illegible] 59

Ronald [illegible]

9873

716

3