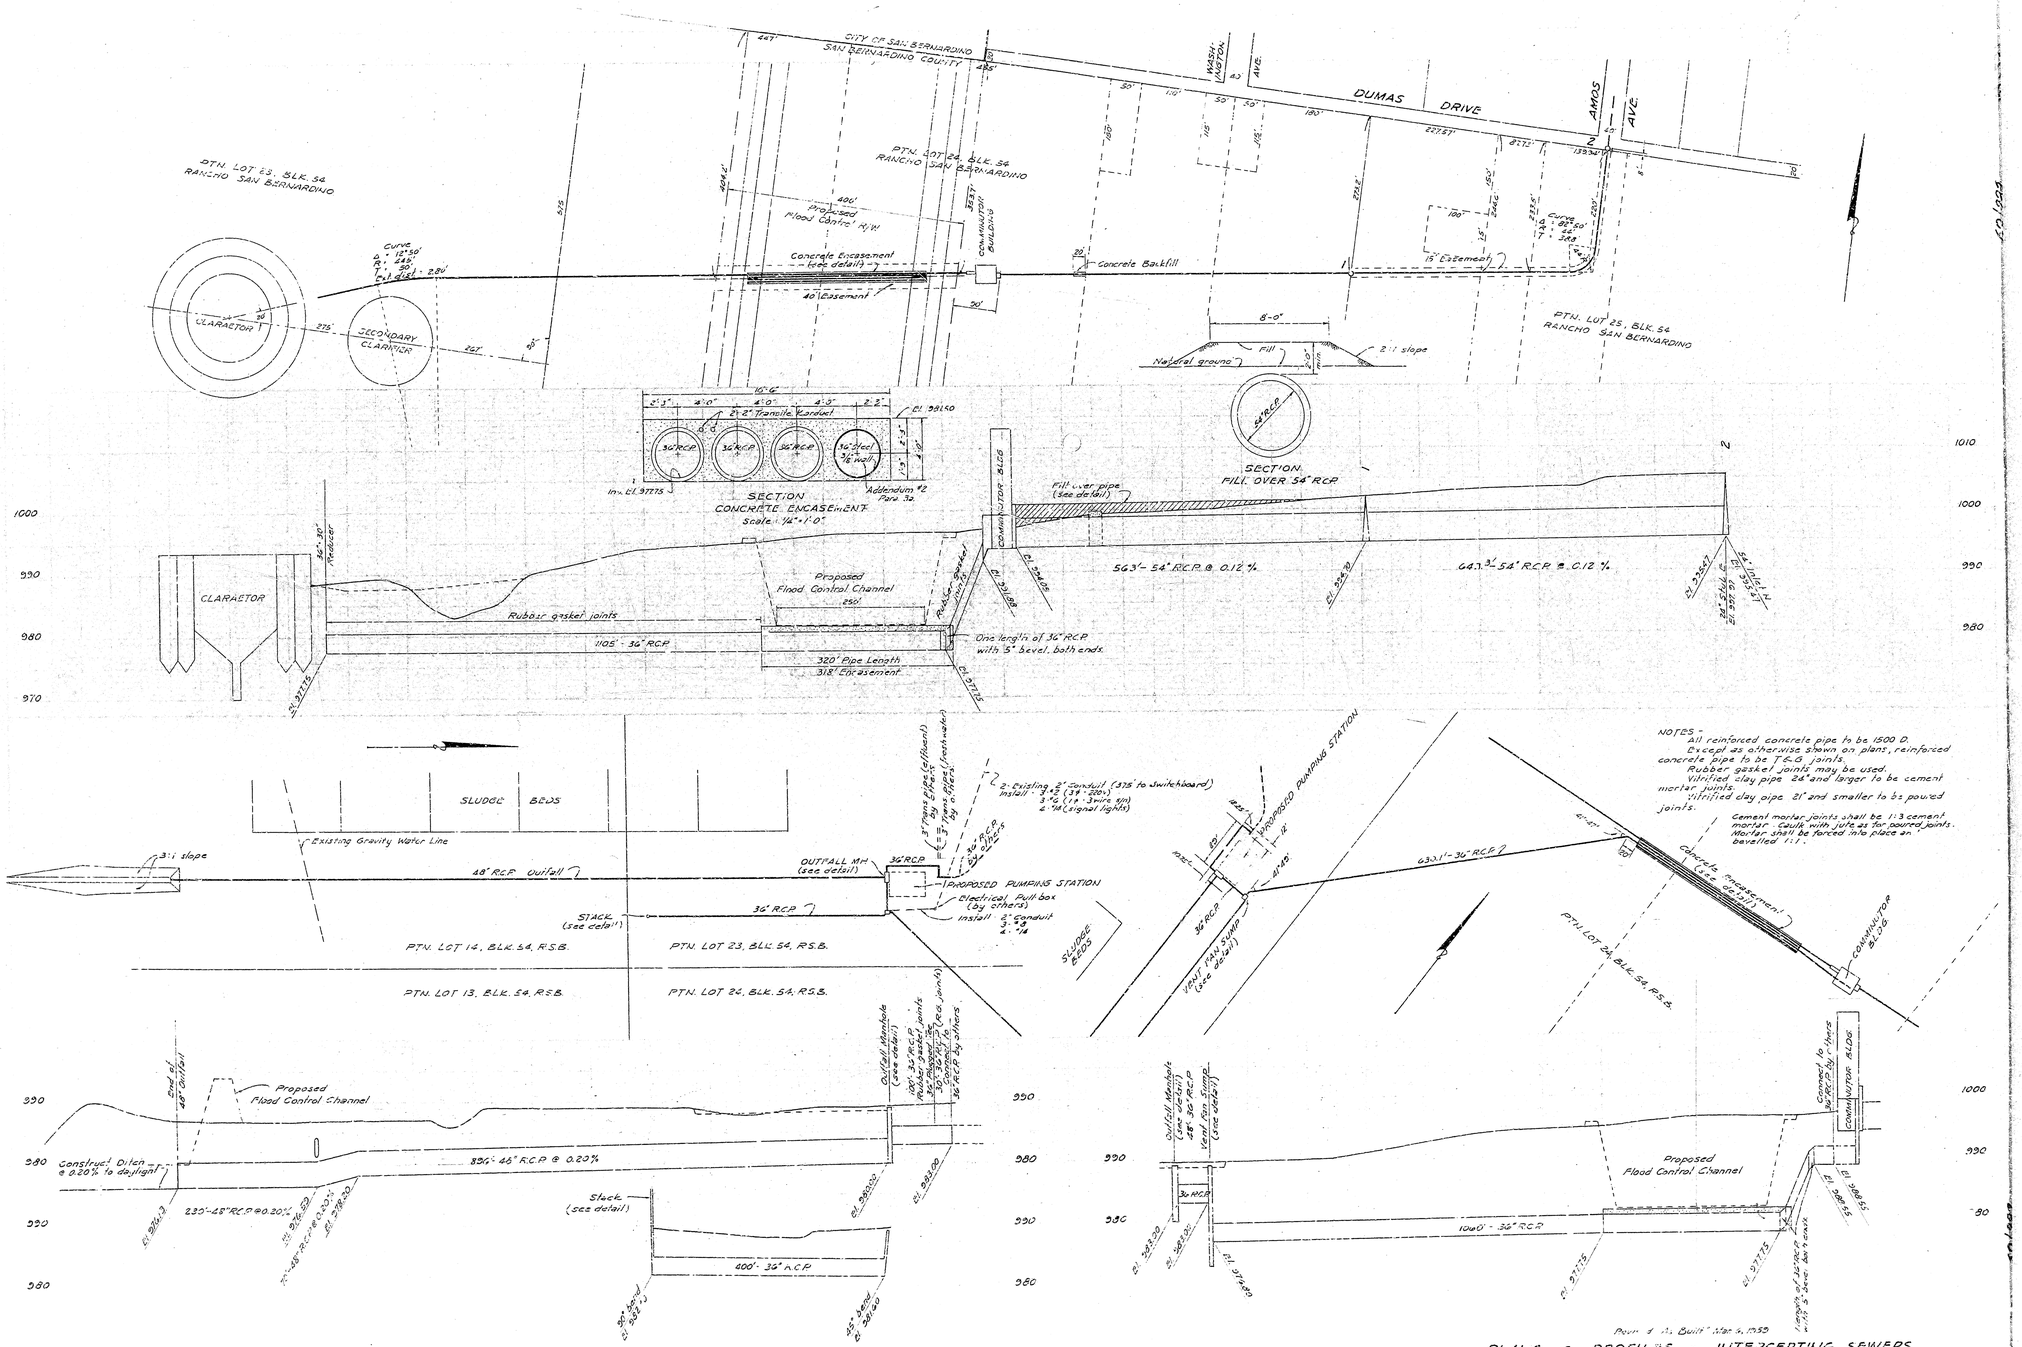

NOTES -
All reinforced concrete pipe to be 1500 D.
Except as otherwise shown on plans, reinforced concrete pipe to be T-G-G joints.
Rubber gasket joints may be used.
Vitrified clay pipe 24" and larger to be cement mortar joints.
Vitrified clay pipe 21" and smaller to be poured joints.

Cement mortar joints shall be 1:3 cement mortar - caulk with jute as for poured joints. Mortar shall be forced into place and beveled 1:1.

Revn. & As Built Mar. 4, 1959

PLANS & PROFILES - INTERCEPTING SEWERS
SAN BERNARDINO, CALIFORNIA. SHEET 2
CURRIE ENGINEERING COMPANY

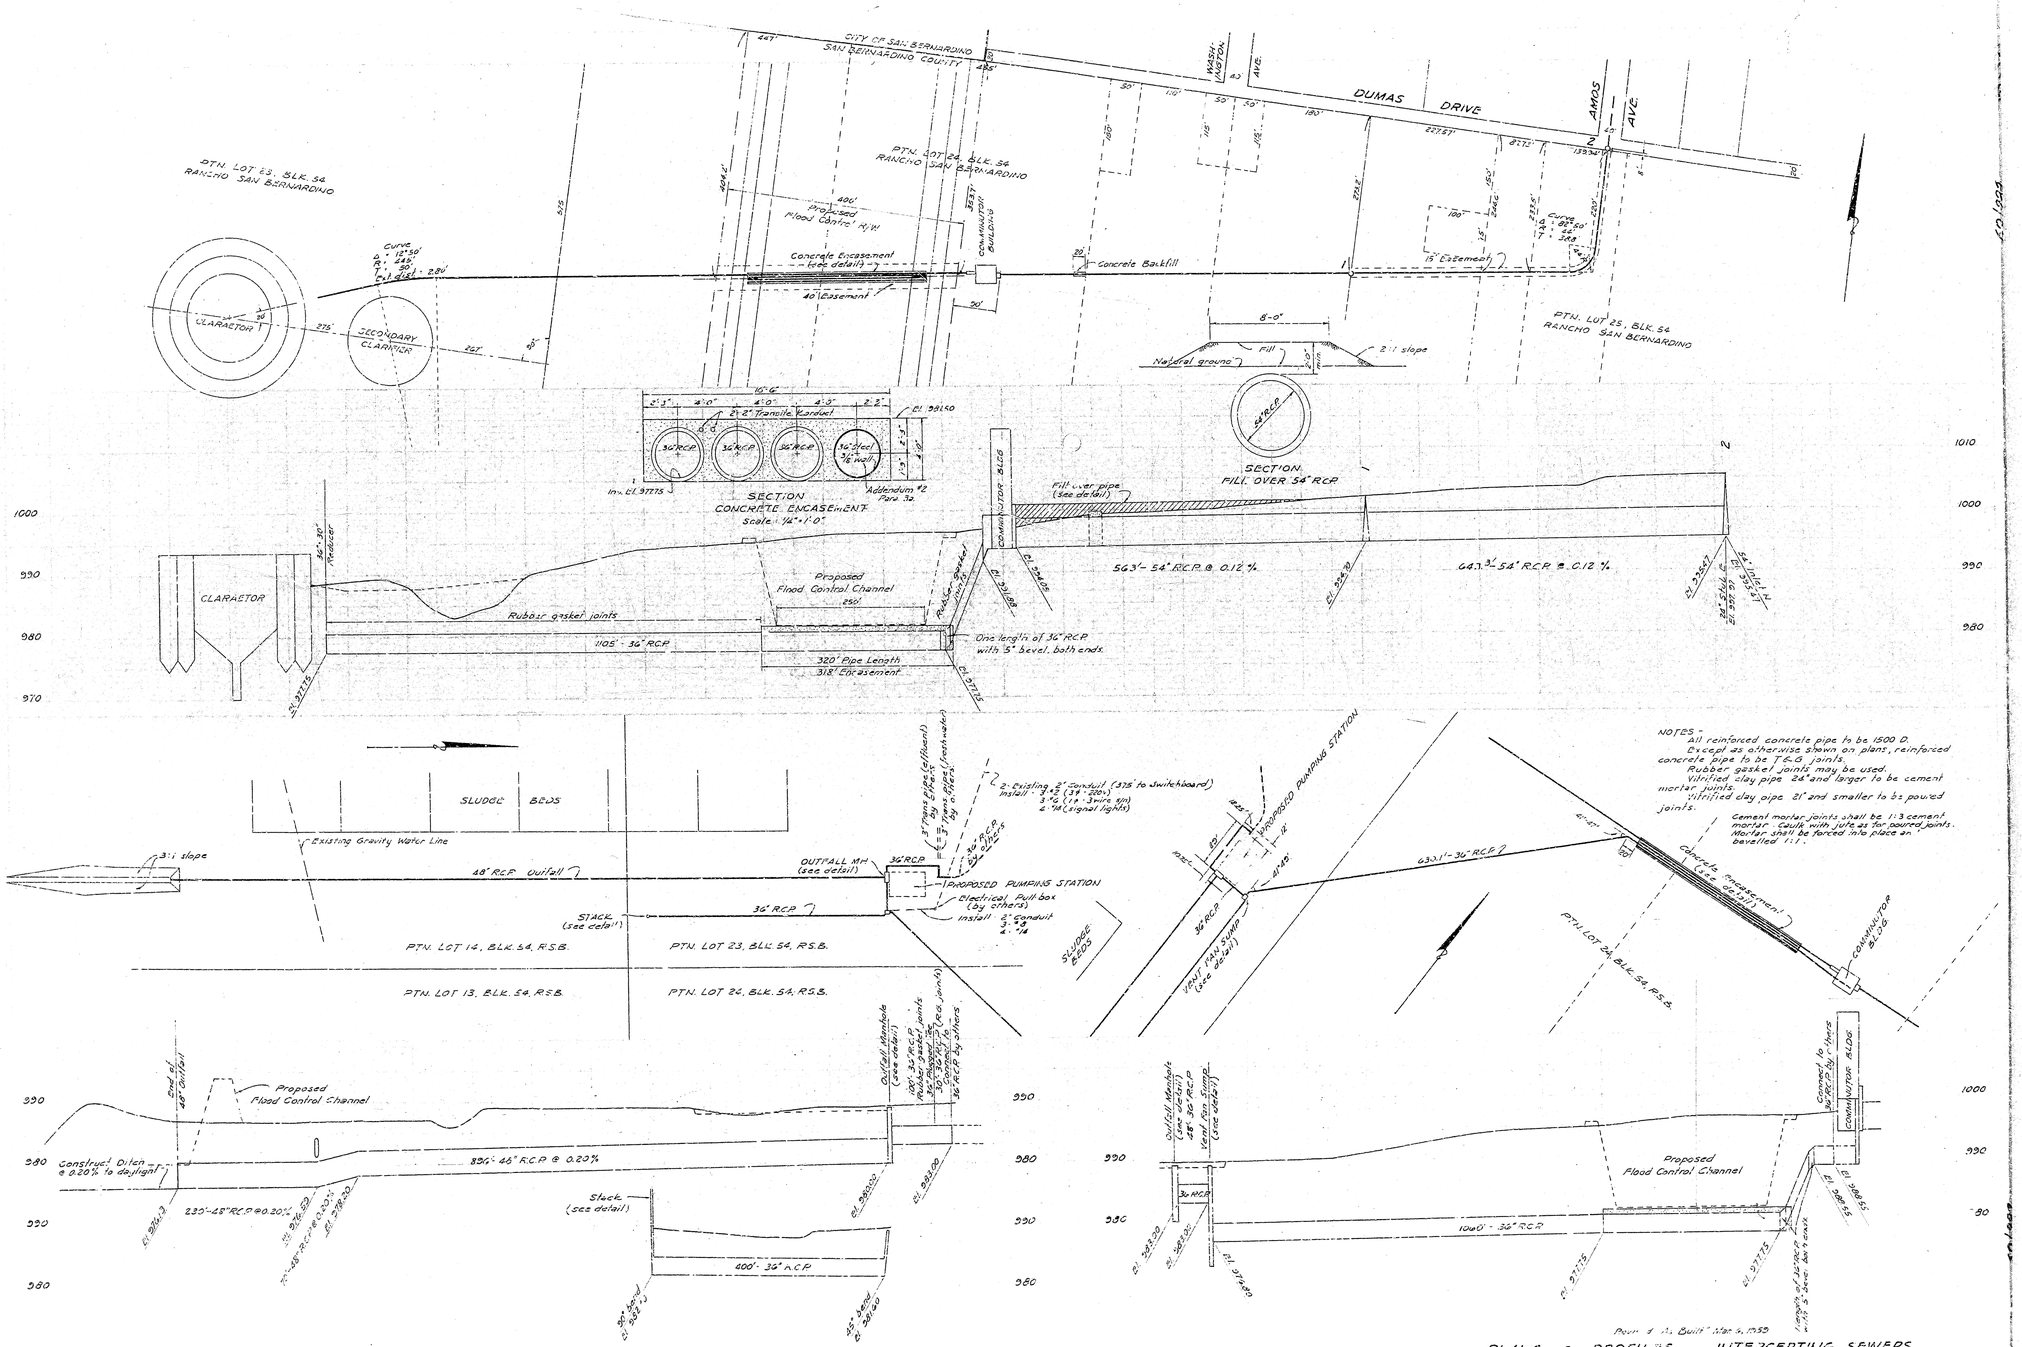

NOTES -
All reinforced concrete pipe to be 1500 D.
Except as otherwise shown on plans, reinforced concrete pipe to be T-G-G joints.
Rubber gasket joints may be used.
Vitrified clay pipe 24" and larger to be cement mortar joints.
Vitrified clay pipe 21" and smaller to be poured joints.

Cement mortar joints shall be 1:3 cement mortar - caulk with jute as for poured joints. Mortar shall be forced into place and beveled 1:1.

Revn. & As Built Mar. 4, 1959

PLANS & PROFILES - INTERCEPTING SEWERS
SAN BERNARDINO, CALIFORNIA. SHEET 2
CURRIE ENGINEERING COMPANY