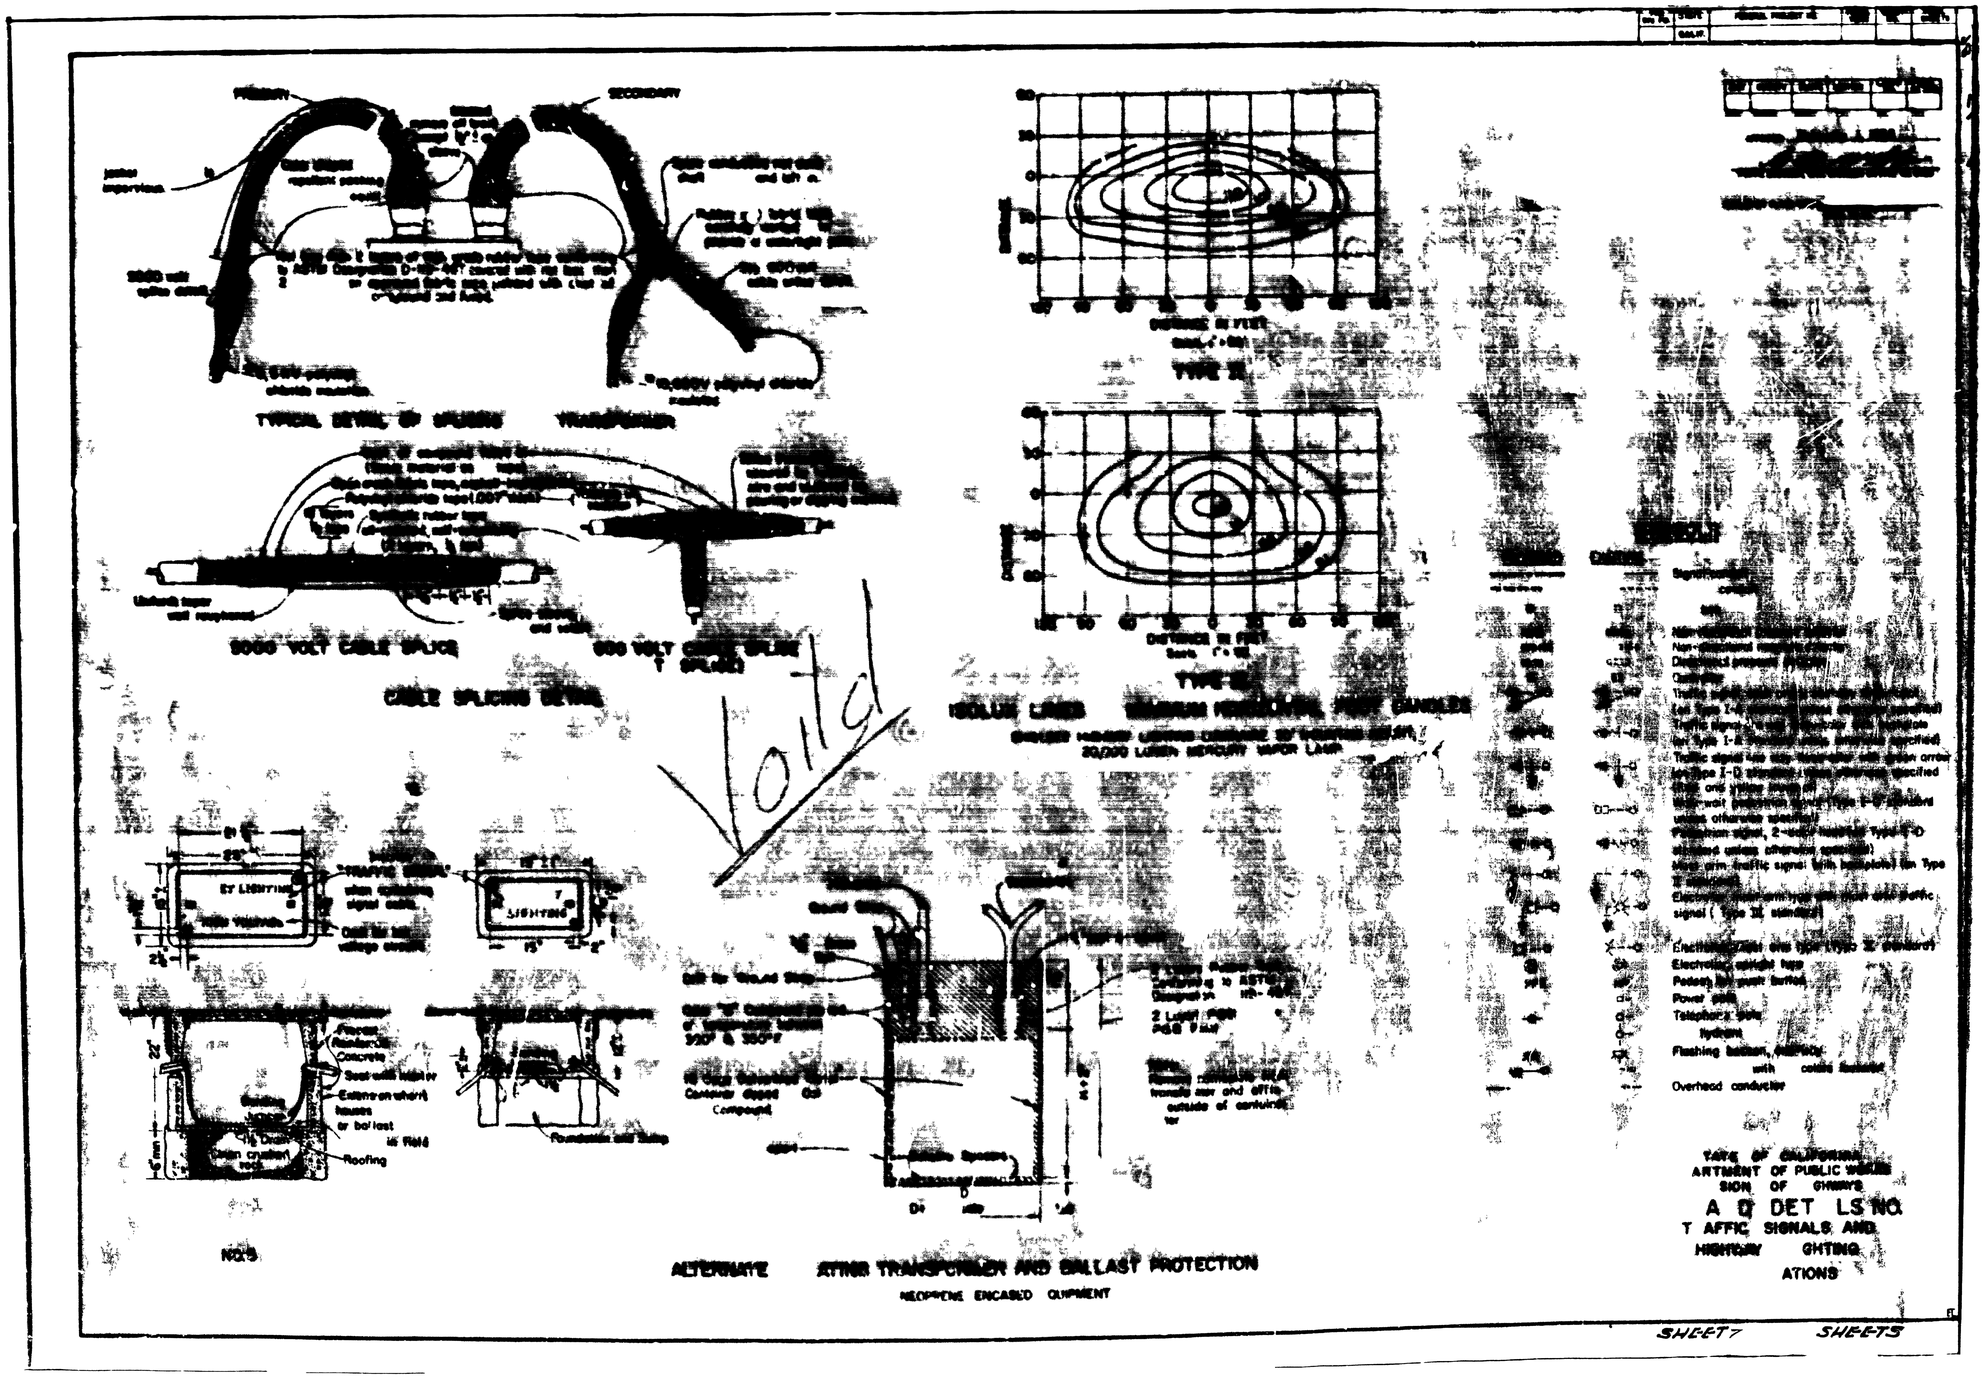
PRIMARY
SECONDARY
TYPICAL DETAIL OF SPLICING TRANSFORMER
5000 VOLT CABLE SPLICE
600 VOLT CABLE SPLICE
T SPLICE
CABLE SPLICING DETAIL
TYPE 2
TYPE 3
DISTANCE IN FEET
ISOLUX LINES
MAXIMUM HORIZONTAL FOOT CANDLES
20,000 LUMEN MERCURY VAPOR LAMP
Void
Concrete
Roofing
Foundation and Footing
Compound
Overhead conductor
NOTES
ALTERNATE OTHER TRANSFORMER AND BALLAST PROTECTION
NEOPRENE ENCASED EQUIPMENT
TATE OF CALIFORNIA
ARTMENT OF PUBLIC WORKS
SION OF HIGHWAYS
A Q DET LS NO.
T AFFIC SIGNALS AND
HIGHWAY GHTING
ATIONS
SHEET 7
SHEETS

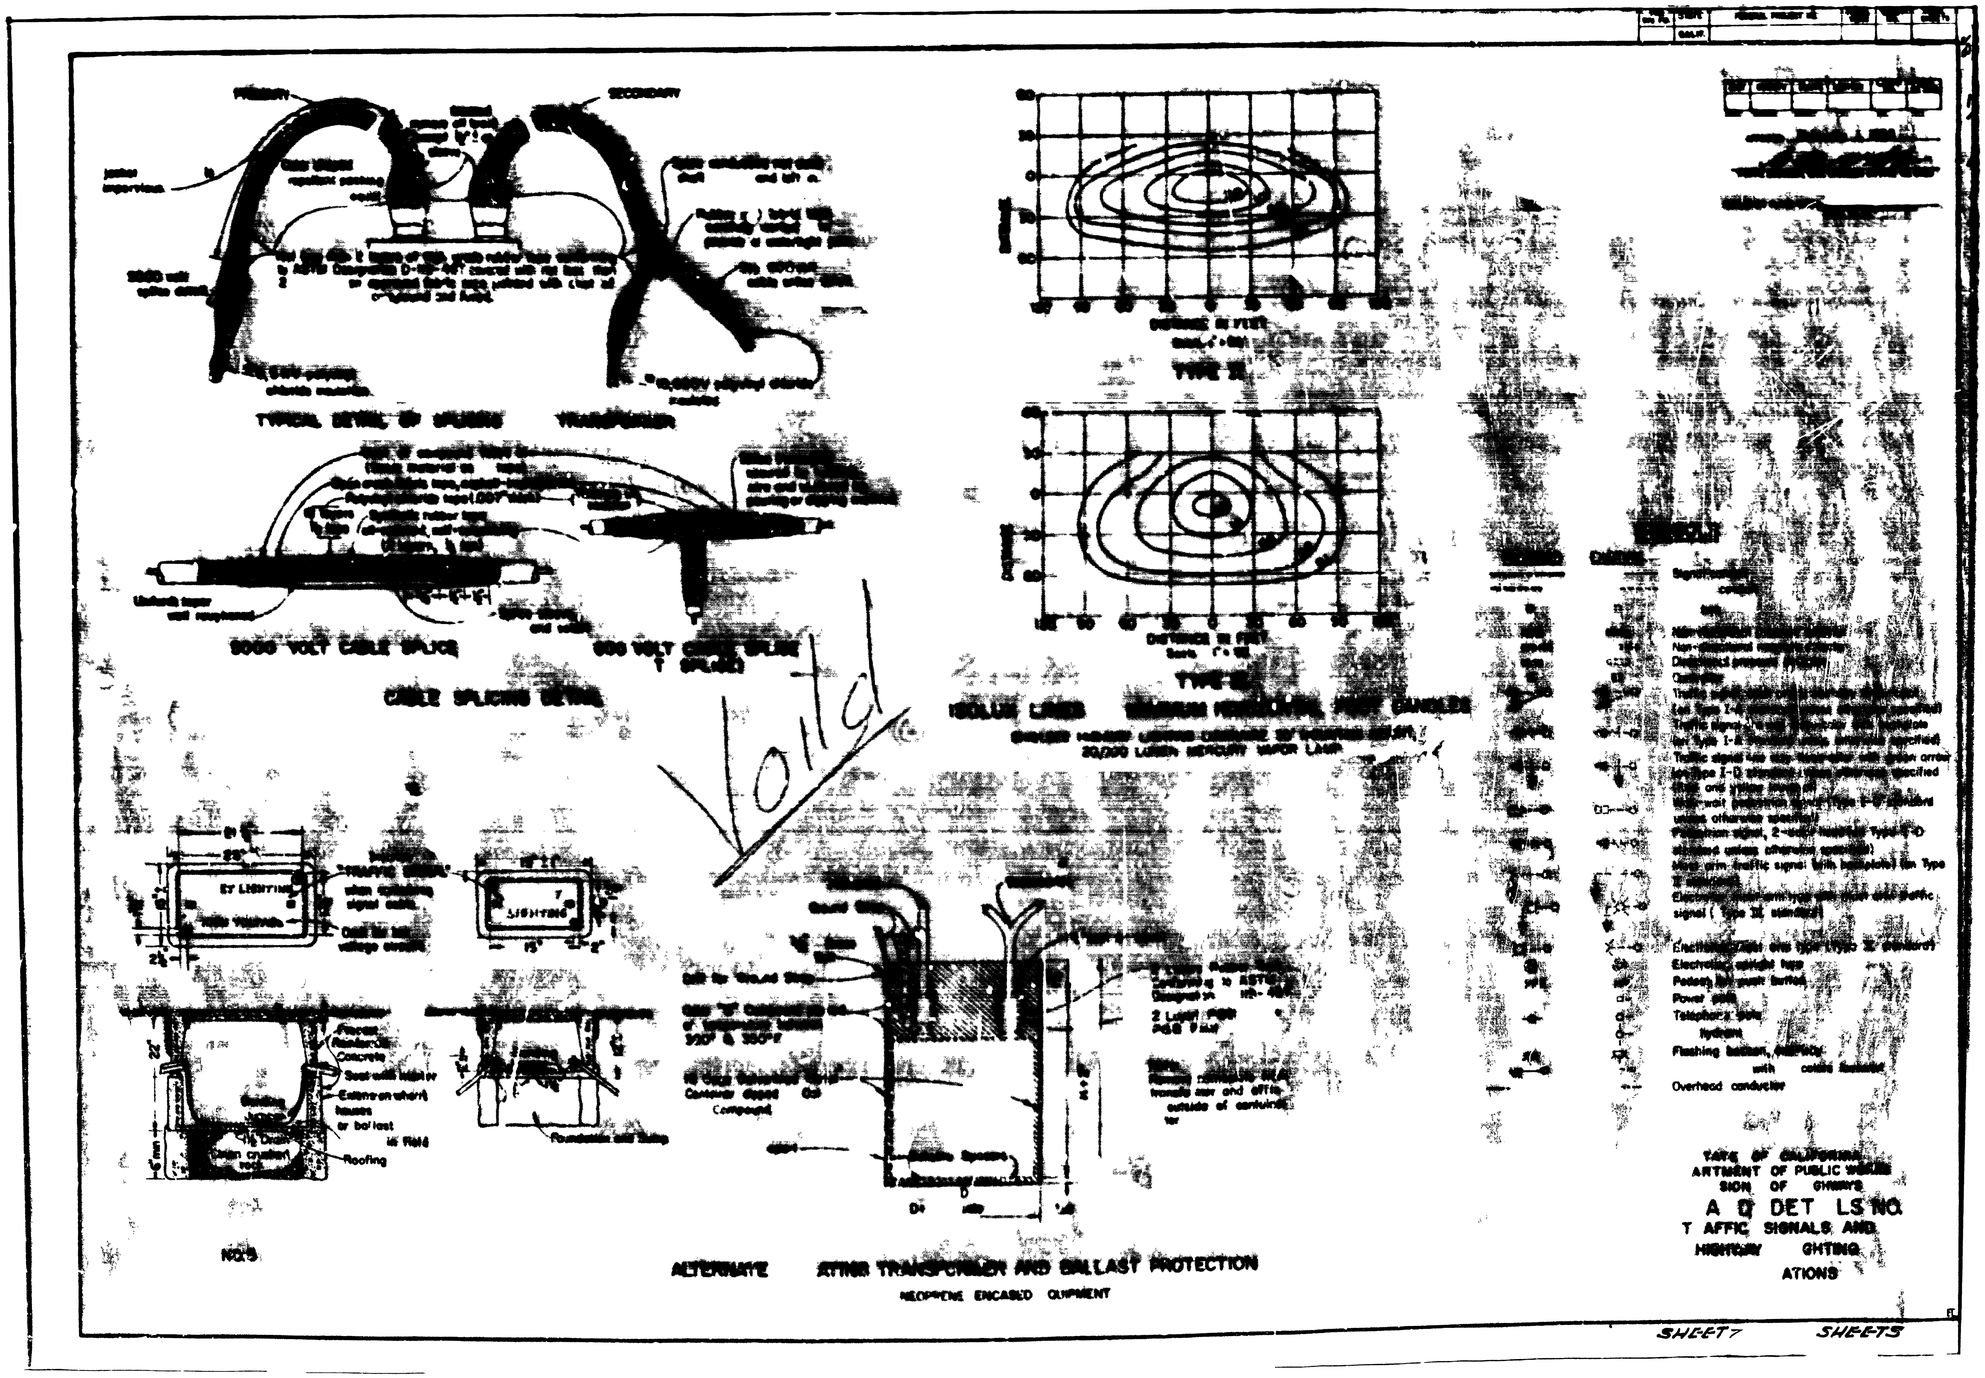
PRIMARY
SECONDARY
TYPICAL DETAIL OF SPLICING TRANSFORMER
5000 VOLT CABLE SPLICE
600 VOLT CABLE SPLICE
T SPLICE
CABLE SPLICING DETAIL
TYPE 2
TYPE 3
DISTANCE IN FEET
ISOLUX LINES
MAXIMUM HORIZONTAL FOOT CANDLES
20,000 LUMEN MERCURY VAPOR LAMP
Void
Concrete
Roofing
Foundation and Footing
Compound
Overhead conductor
NOTES
ALTERNATE OTHER TRANSFORMER AND BALLAST PROTECTION
NEOPRENE ENCASED EQUIPMENT
TATE OF CALIFORNIA
ARTMENT OF PUBLIC WORKS
SION OF HIGHWAYS
A Q DET LS NO.
T AFFIC SIGNALS AND
HIGHWAY GHTING
ATIONS
SHEET 7
SHEETS