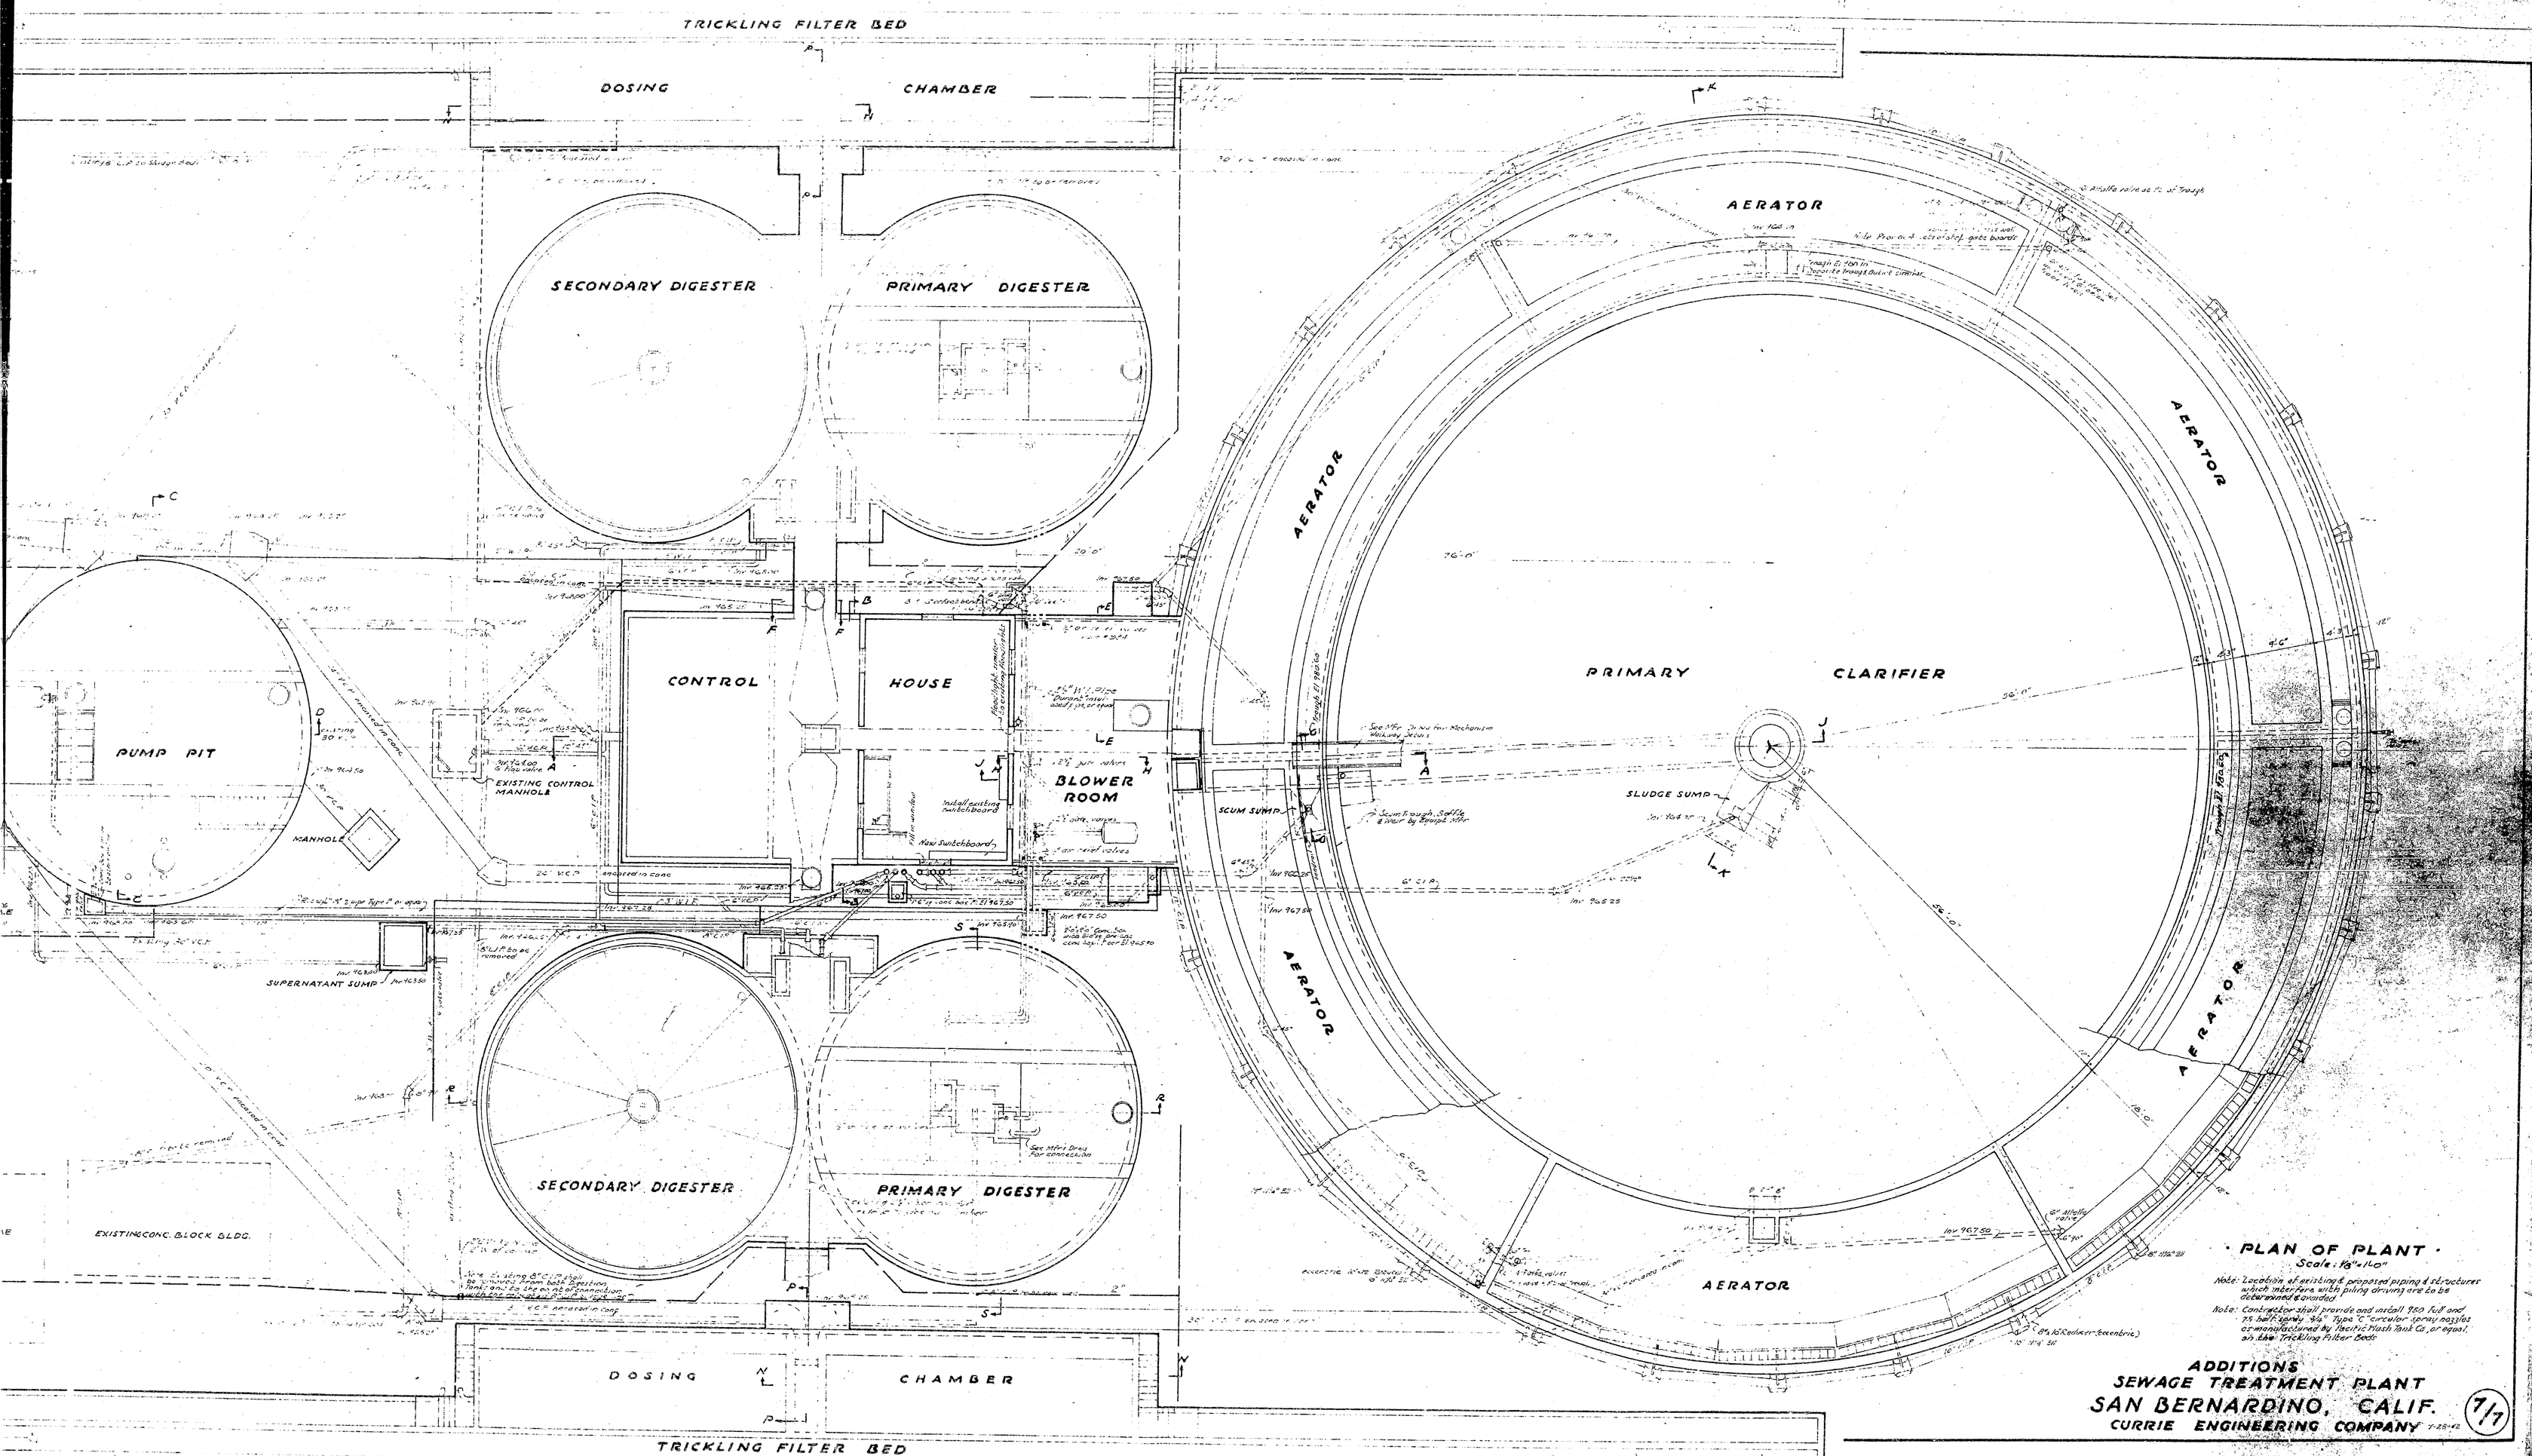

· PLAN OF PLANT ·

Scale: 1/8" = 1'-0"

Note: Location of existing & proposed piping & structures which interfere with piling driving are to be determined & provided

Note: Contractor shall provide and install 1800 full and 25 half "Ejowl" Type "C" circular spray nozzles as manufactured by Pacific Flush Tank Co., or equal, on the Trickling Filter Beds

ADDITIONS
SEWAGE TREATMENT PLANT
SAN BERNARDINO, CALIF.
CURRIE ENGINEERING COMPANY 7-25-42

7/7